


SECTION A-A

BACKFLOW & IRRIGATION DETAIL

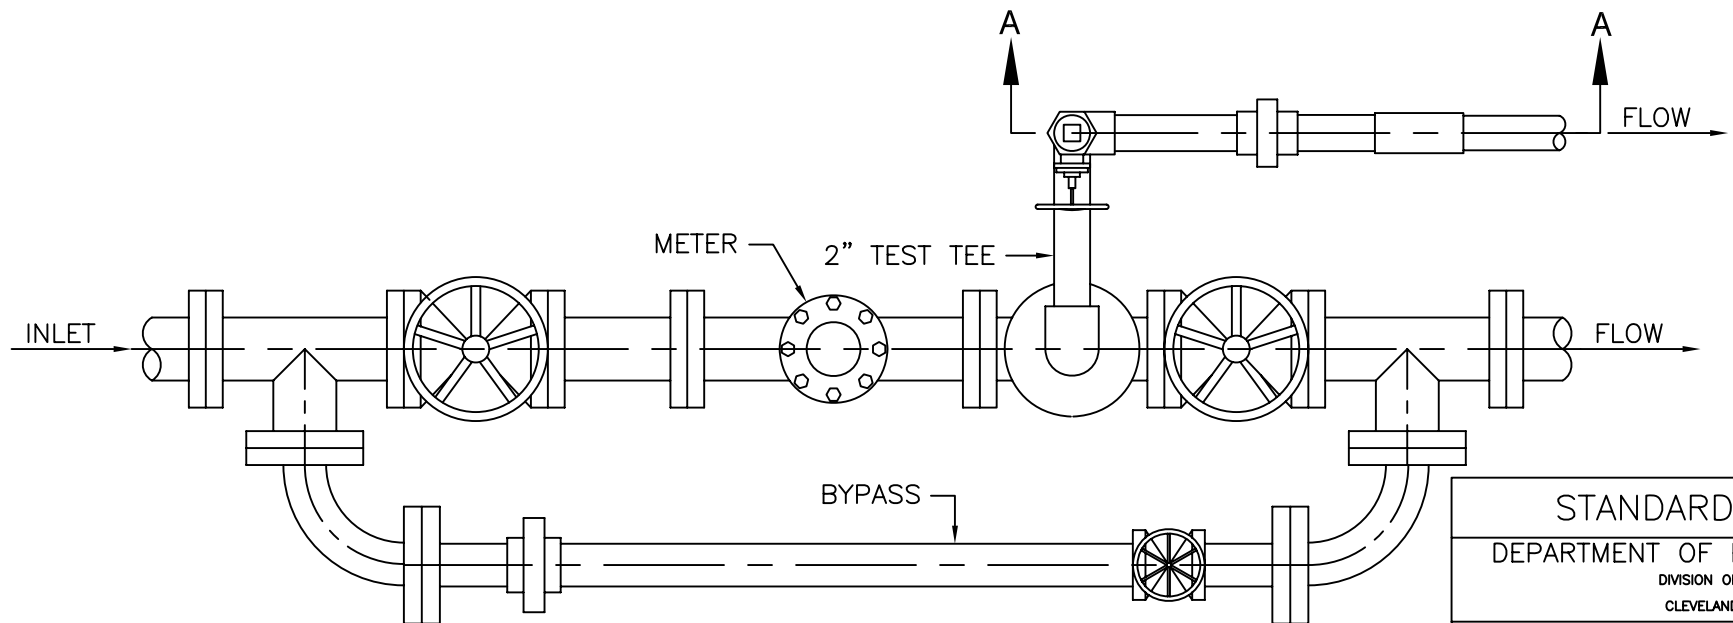

PLAN

STANDARD DETAILS		
DEPARTMENT OF PUBLIC UTILITIES		
DIVISION OF WATER		
CLEVELAND, OHIO		
SUBJECT _____		
TYPICAL 3", 4", 6" AND 8" METER SETTINGS WITH		
1", 1½" OR 2" LAWN SPRINKLER CONNECTION		
DRAWN BY <u>RSK</u>	SCALE	STD-M15
DATE <u>1-4-2010</u>	NONE	
CHECKED BY _____	DATE _____	

* FOR TYPE AND MODEL OF BACKFLOW DEVICE REQUIRED CONTACT THE BACKFLOW UNIT AT (216) 664-3944.