


PLAN

METER SIZE	DIM. "A"
5/8"	12 1/2"
1"	16"

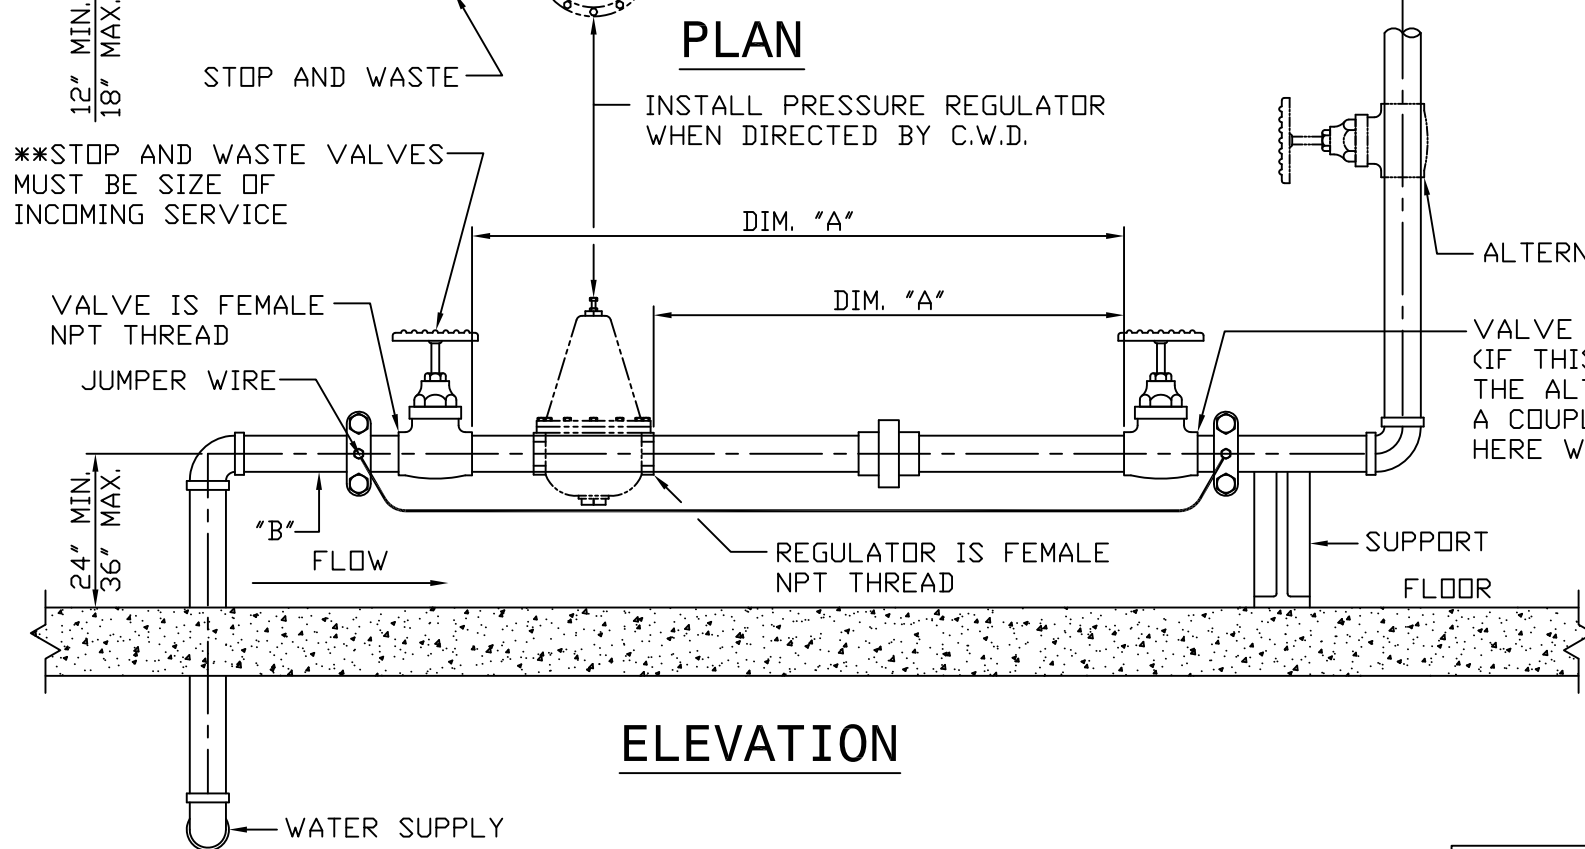

ELEVATION

**STOP AND WASTE VALVES MUST BE SIZE OF INCOMING SERVICE

INSTALL PRESSURE REGULATOR WHEN DIRECTED BY C.W.D.

VALVE IS FEMALE NPT THREAD

JUMPER WIRE

"B"
FLOW

REGULATOR IS FEMALE NPT THREAD

ALTERNATE VALVE LOCATION

VALVE IS FEMALE NPT THREAD (IF THIS VALVE IS PLACED IN THE ALTERNATE LOCATION THEN A COUPLING MUST BE INSTALLED HERE WITH FEMALE NPT THREADS)

* NOTE: IF METER SIZE IS REDUCED FROM THE INCOMING LINE SIZE, THE APPROPRIATE REDUCTION SHOULD TAKE PLACE AT POINT "B".

** BALL VALVES MAY BE USED IN PLACE OF STOP AND WASTE VALVES.

*** IF WATER SERVICE IS FOR ANYTHING OTHER THAN A SINGLE OR 2 FAMILY HOUSE, A BACKFLOW PREVENTION DEVICE IS REQUIRED. FOR TYPE AND MODEL OF BACKFLOW DEVICE REQUIRED CONTACT THE WATER BACKFLOW UNIT AT 216-664-3944.

STANDARD DETAILS

DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER
CLEVELAND, OHIO

SUBJECT APPROVED INSIDE BUILDING
METER SETTINGS

FOR 5/8", 1" METERS

DRAWN BY RSK -SCALE-
DATE 11-3-2011 NONE
CHECKED BY DATE

STD-M17